


REVISION No. 9

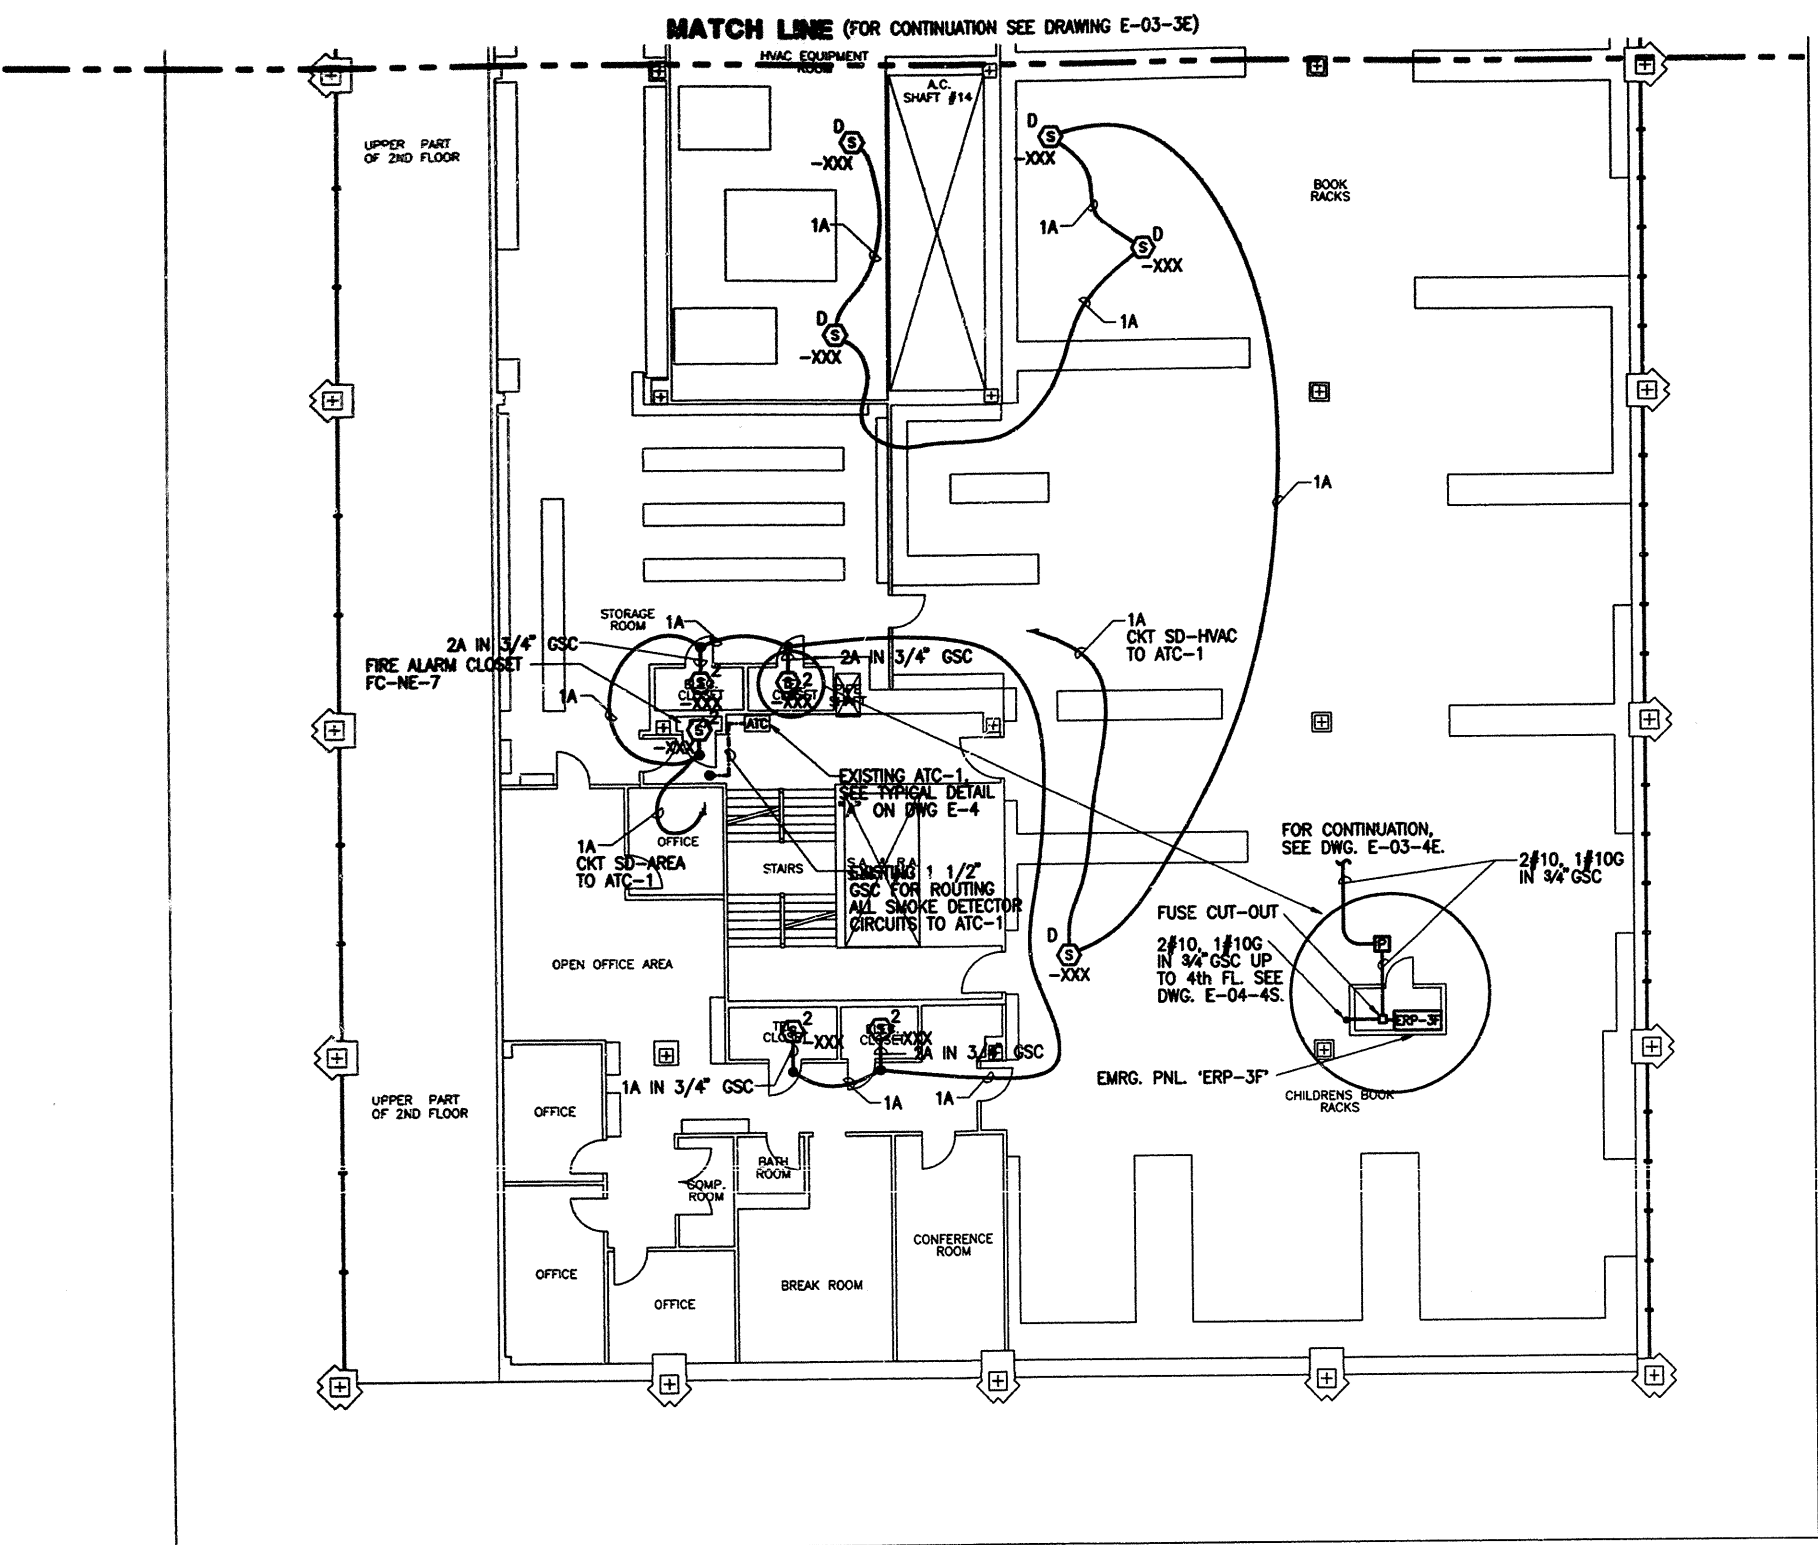

**NOTES**

1. FOR LEGEND, ABBREVIATIONS, AND GENERAL NOTES, SEE DWG. E-1. FOR INSTALLATION DETAILS, SEE DWGS. E-2 AND E-4. FOR WIRING DIAGRAMS, SEE DWGS. E-3 AND E-4.
2. NOT USED
3. NOT USED
4. FOR RETURN AIR SMOKE DETECTORS ARRANGEMENT AND NOTES, SEE DWG. M-1.
5. NOT USED
6. NOT USED

Sheet 14 of 84



*[Signature]*  
ENGINEERING PROGRAM MANAGER  
WORLD TRADE CENTER  
CHIEF ELECTRICAL ENGINEER

No.	Date	Revision	Approved
-----	------	----------	----------

ENGINEERING DEPARTMENT

WORLD  
TRADE  
CENTER

**ELECTRICAL**

Title  
**FIRE ALARM SYSTEM  
DEVICE UPGRADE  
PHASE III  
5 WTC 3rd, 4th, 5th & 6th FLOORS**

**3rd FLOOR  
SMOKE DETECTOR LAYOUT  
INSTALLATION  
SOUTH PART PLAN**

This drawing subject to conditions in Contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

S. FELDSTEIN S. ANSINE A.S.  
Designed by Drawn by Checked by

NOVEMBER 26, 1999  
Date

WTC-861.573 E-03-3S  
Contract Number Drawing Number

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE CONTRACT DRAWINGS CONSTITUTING A PART OF CONTRACT NO. **WTC-861.573** IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT THE TIME THE SAID CONTRACT WAS EXECUTED BY THE PARTIES.

DATE *2/1/00* *[Signature]* CONTRACT ENGINEER/ARCH.  
DATE *2/1/00* *[Signature]* ENGINEERING PROGRAM MGR.

